


Drawing File: \\VA301A\5317-Correct Facility Life Safety Deficiencies\Drawings\5317 FP102.dwg  
Plotted by: microvell  
Plotted Date: Sep 04, 2014 - 2:32pm

A three inches = one foot  
B one and one-half inches = one foot  
C one inch = one foot  
D three-quarters inch = one foot  
E one-half inch = one foot  
F three-eighths inch = one foot  
G one-quarter inch = one foot  
H one-eighth inch = one foot

ROOM BC-105B - FIRE PROTECTION


SCALE: 1/2" = 1'-0"



LINEN STORAGE  
BC-102B

ROOM BC-102B - FIRE PROTECTION

SCALE: 1/2" = 1'-0"




NOTES:  
(THIS SHEET ONLY)

- ① CONNECT TO NEAREST EXISTING SPRINKLER PIPING AND ADD A PENDENT SPRINKLER HEAD TO PROVIDE COVERAGE IN ACCORDANCE WITH NFPA 13.

GENERAL NOTES:  
(THIS SHEET ONLY)

1. ALL MATERIALS AND EQUIPMENT USED ON THIS PROJECT SHALL BE UL LISTED AND FM APPROVED.
2. EXISTING PIPING IS THREADED SCHEDULE 40 BLACK STEEL PIPE. NEW PIPING SHALL MATCH EXISTING.
3. EXISTING PIPING WILL BE PERMITTED TO BE REUSED BUT FITTINGS AND HEADS SHALL BE NEW.
4. ALL PIPING AND EQUIPMENT INSTALLED ON THIS PROJECT SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 13 AND VA FIRE PROTECTION DESIGN GUIDE.
5. ALL NEW PENDENT HEADS INSTALLED SHALL BE ON A RETURN BEND CONFIGURATION.

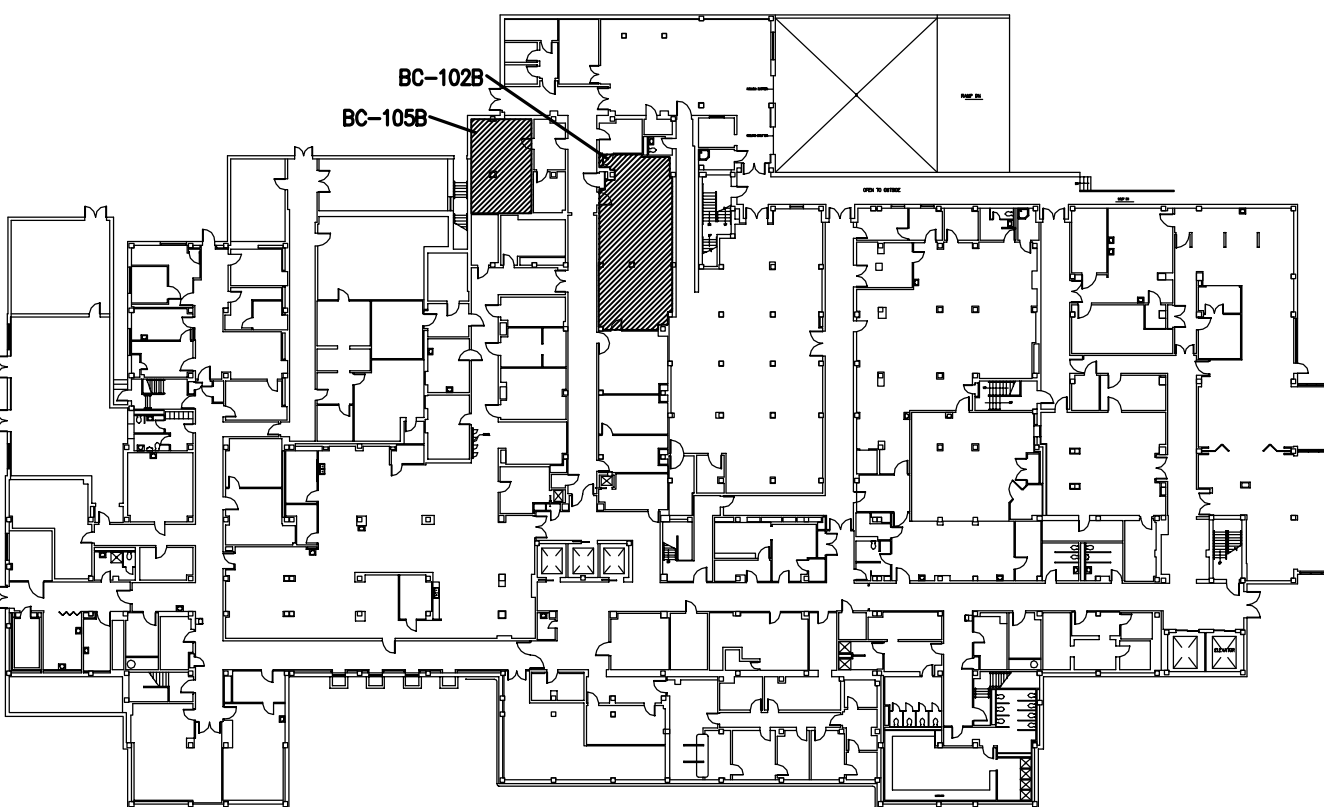

BASEMENT KEY PLAN

SCALE: NTS

Revisions	Date



CORPORATE OFFICE  
590 Means St. NW, Ste. 200  
Atlanta, GA 30318  
404.214.9774



CLARK•NEXSEN

440 MARTIN LUTHER KING, JR. BLVD  
MACON, GEORGIA 31201  
478-743-8415 FAX 478-743-8239  
WWW.CLARKNEXSEN.COM

Drawing Title PARTIAL BASEMENT PLAN FIRE PROTECTION
Approved Project Engineer

Project Title		
CORRECT LIFE SAFETY DEFICIENCIES BECKLEY VAMC		
FINAL SUBMITTAL		
Building Number	Checked	Drawn
-	RC	PW
Location		
BECKLEY, W.V.		

Date 09-05-2014
Project No. 517-14-106
DRAWING NO. FP102
Dwg. XX Of XX

Veterans  
Administration